

NORTH HARDIN
 WATER SUPPLY CORPORATION
 WATER DISTRIBUTION SYSTEM

NOVEMBER 2007

*Carroll &
 Blackman,
 Inc.*

PREPARED BY:

*Consulting Engineers & Surveyors
 3120 Fannin Street
 Beaumont, Texas 77701
 (409) 833-3363*



SCALE: 1"=300'

LEGEND

- GATE VALVE
- FLUSH VALVE
- ⊕ FIRE HYDRANT
- SAMPLE SITE

FIRE TOWER RD



SHADY OAK DR
WESTERN HILLS DR

DISTRICT BOUNDARY

OLD KOUNTZE RD


SHEET 2

SHEET 7

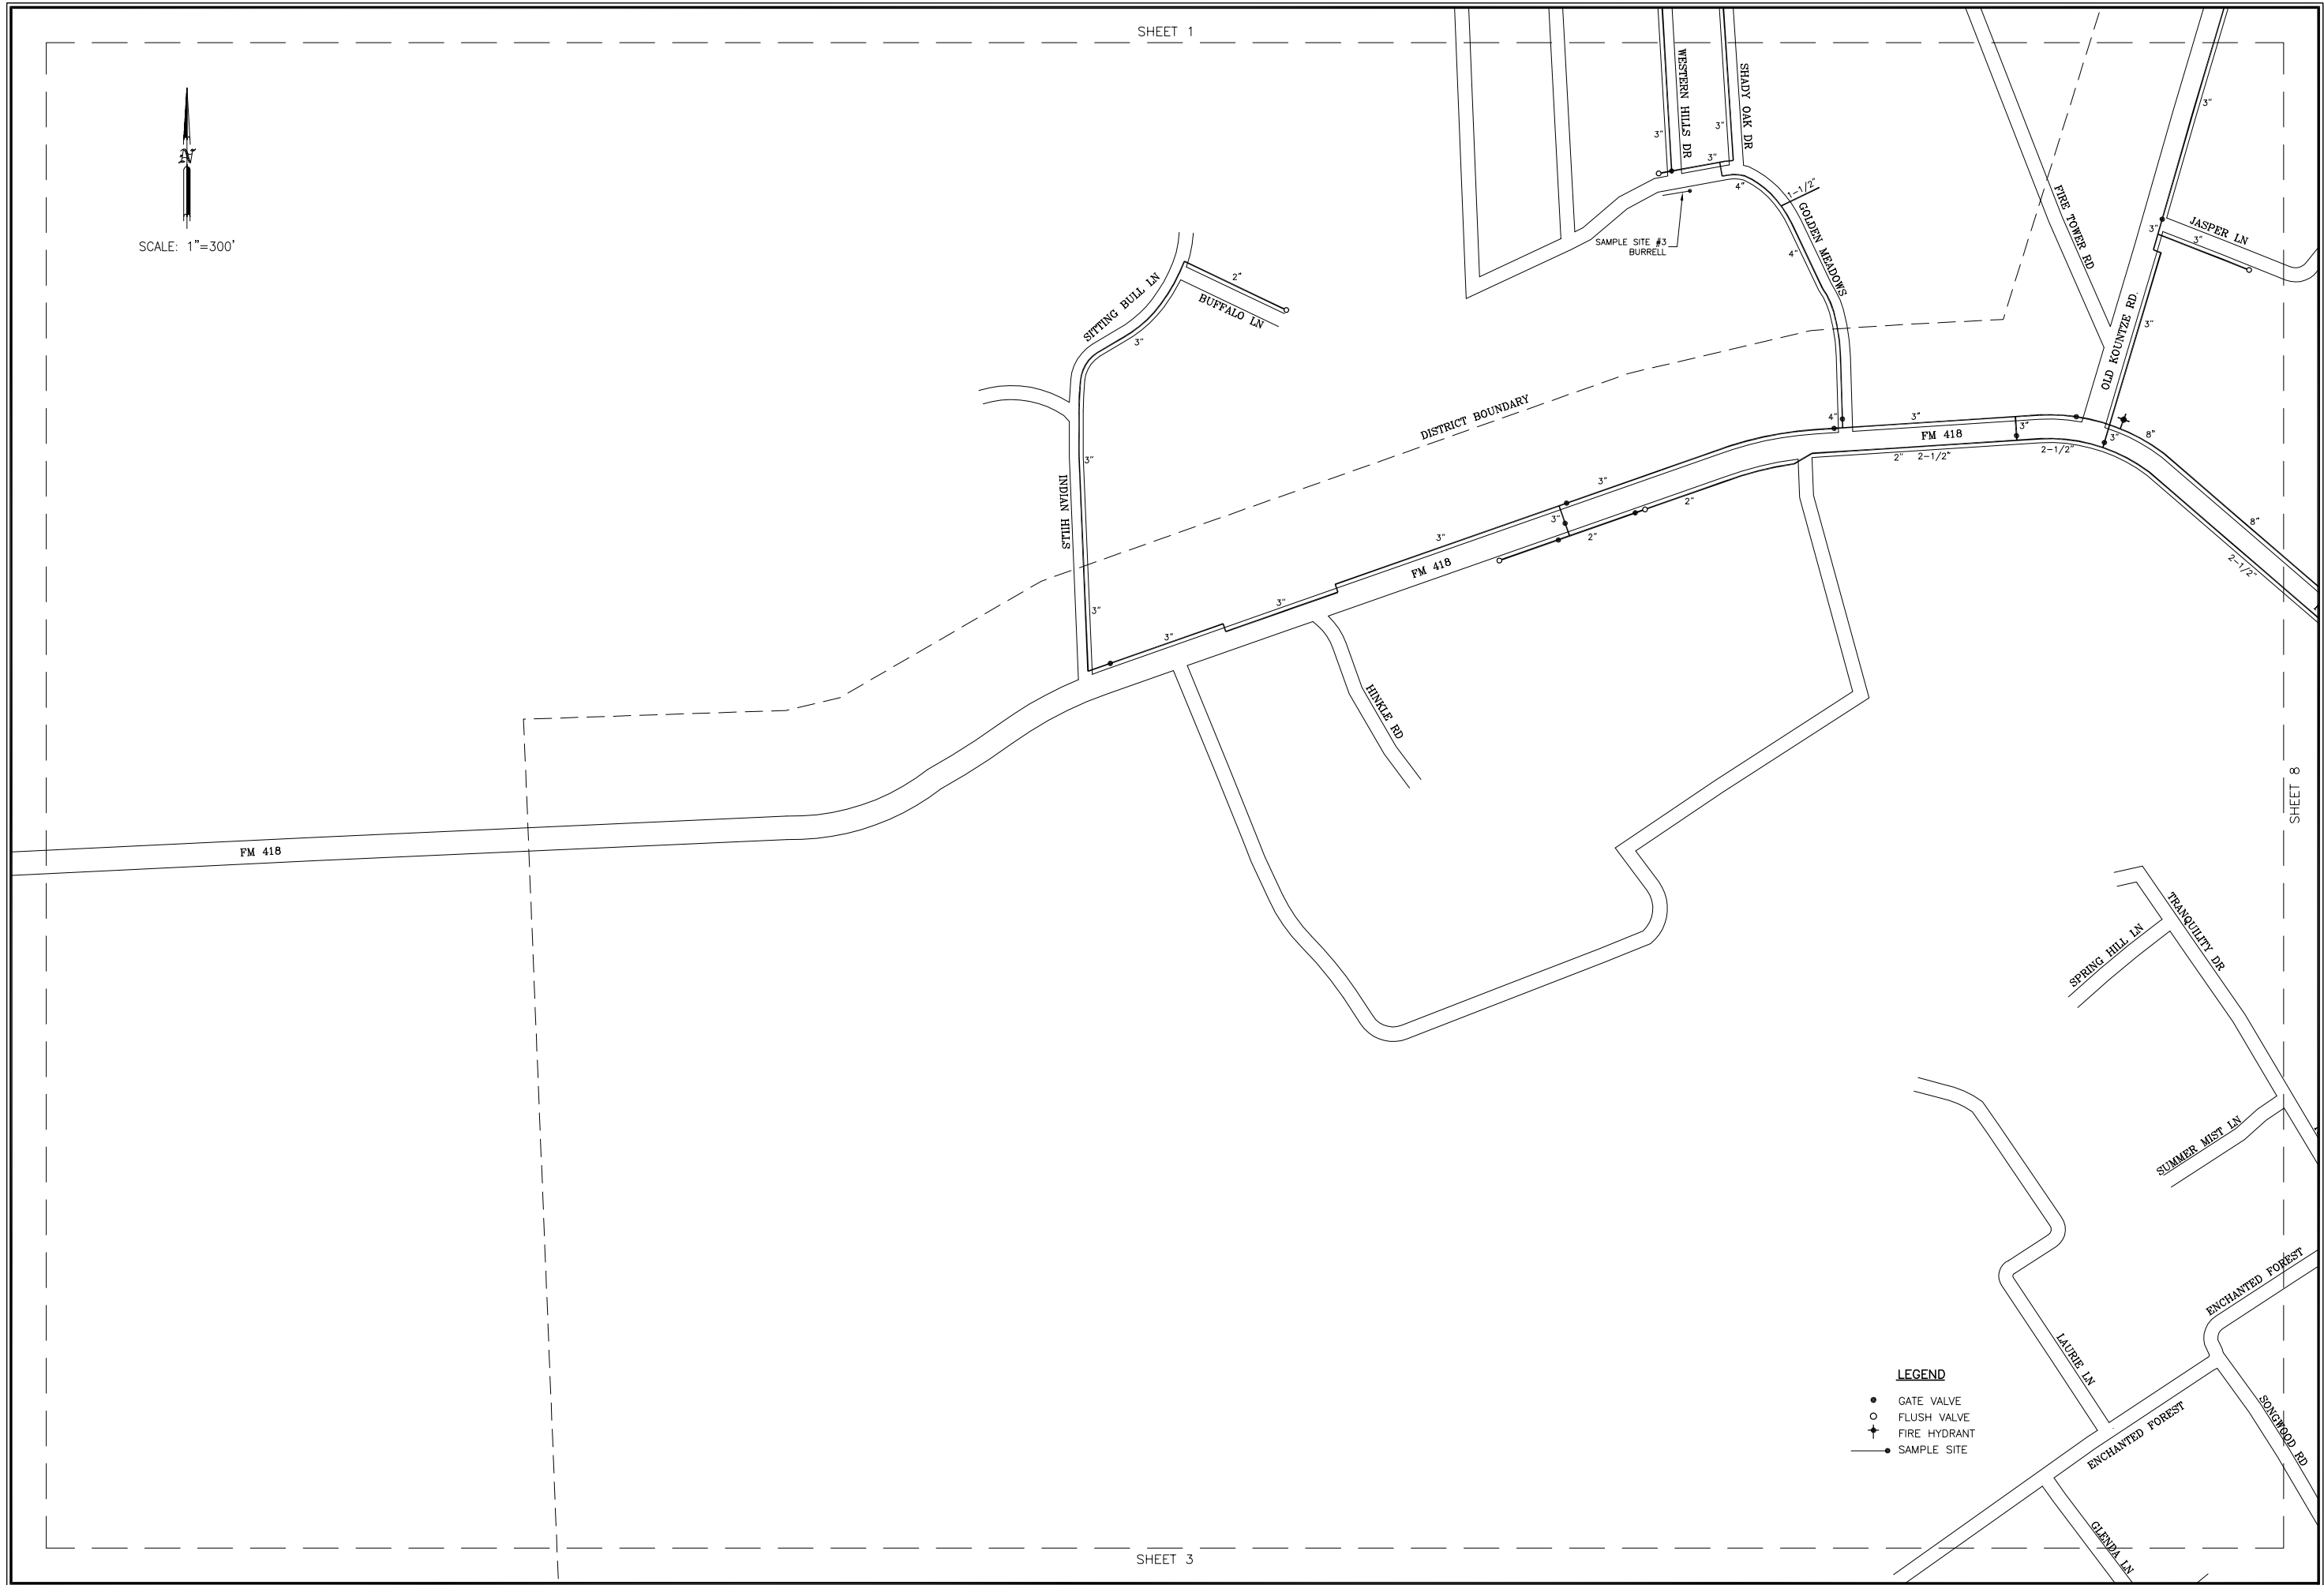



SCALE: 1"=300'

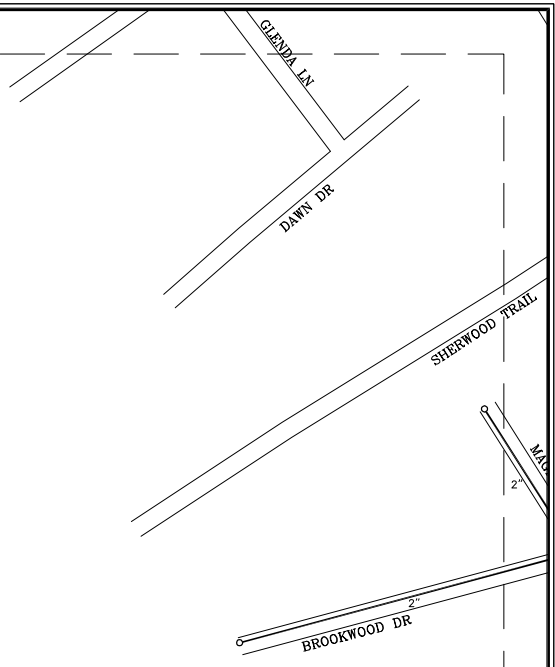

SHEET 9

DISTRICT BOUNDARY

- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE



SCALE: 1"=300'

DISTRICT BOUNDARY

SHEET 13

GORE STORE RD

2"

2"

LEGEND

- GATE VALVE
- FLUSH VALVE
- ⊕ FIRE HYDRANT
- SAMPLE SITE

SHEET 5



SCALE: 1"=300'

DISTRICT BOUNDARY

OLD KOUNTZE RD

LEGEND

- GATE VALVE
- FLUSH VALVE
- ⊕ FIRE HYDRANT
- SAMPLE SITE



SCALE: 1"=300'

SHEET 5

DISTRICT BOUNDARY

OLD ROUNDY RD

DUBURY

SHEET 15

AIRLINE

LEGEND


- GATE VALVE
- FLUSH VALVE
- ⊕ FIRE HYDRANT
- SAMPLE SITE

SHEET 7

SCALE: 1"=300'



- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE




SHEET 3

SHEET 18

- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - † FIRE HYDRANT
 - SAMPLE SITE

SCALE: 1"=300'


- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE

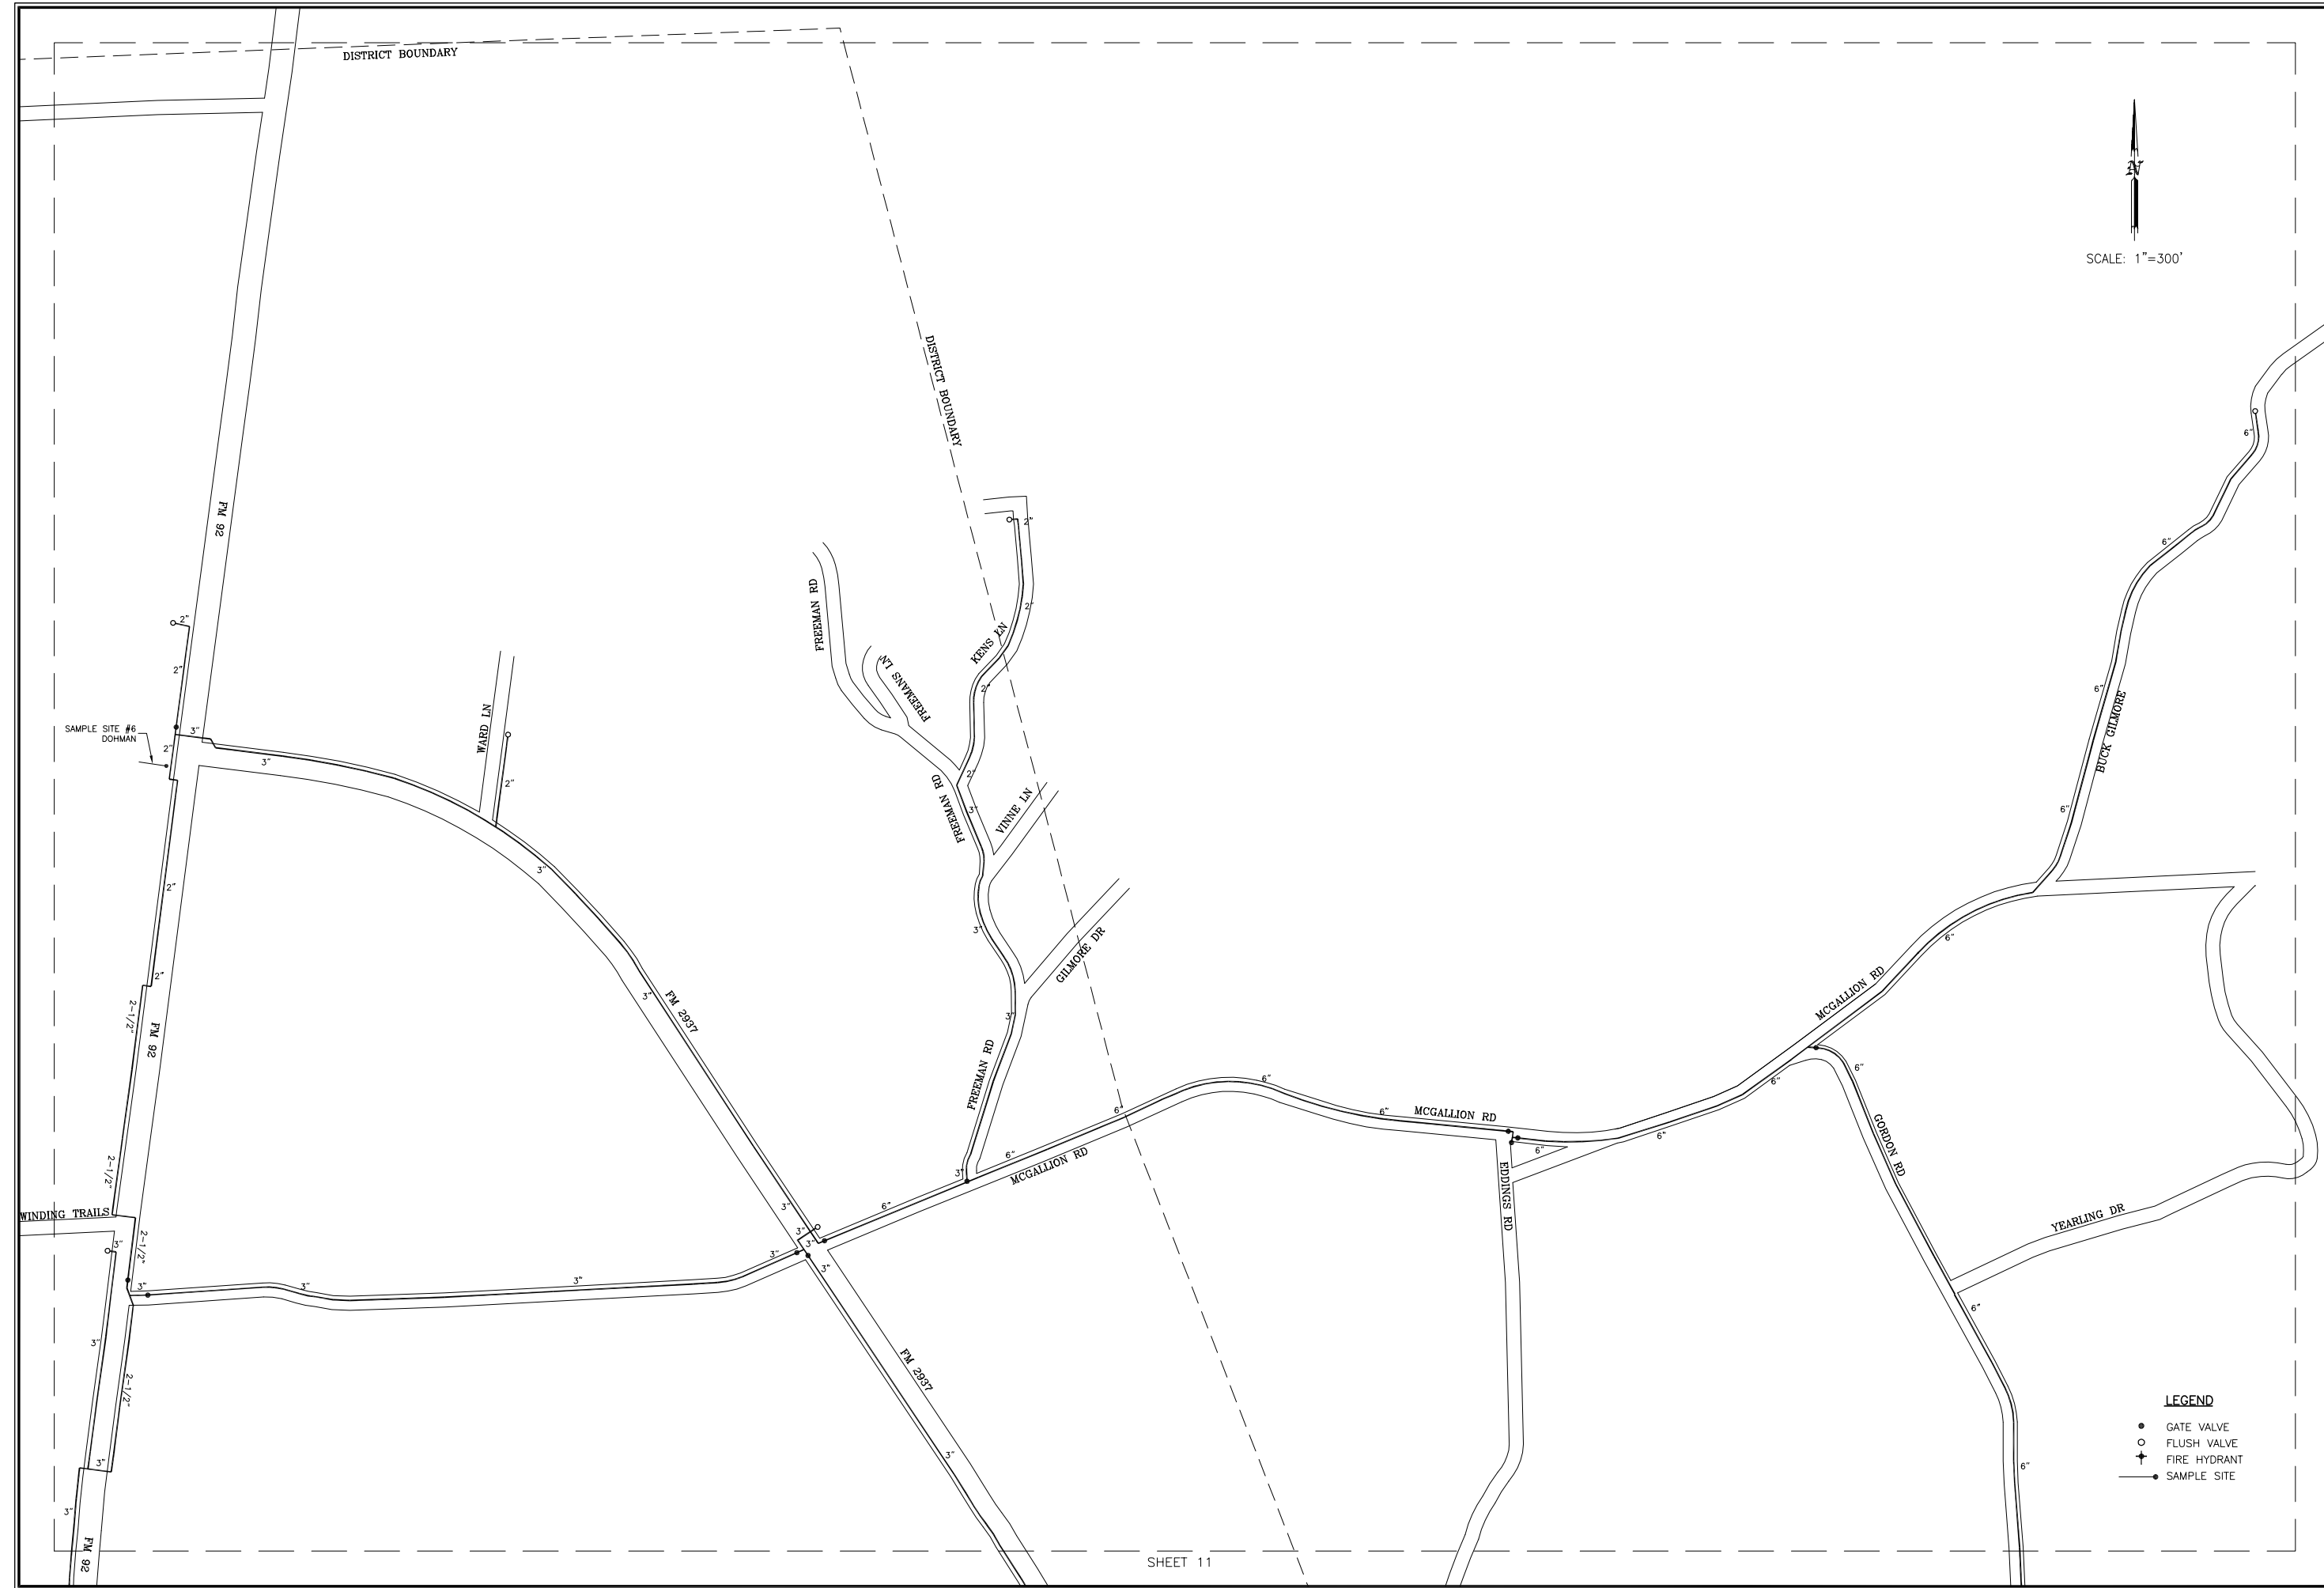


SHEET 11

SHEET 10 OF 23

SCALE: 1"=300'



- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE



SCALE: 1"=300'

TARVER

PM 2987

MCINNIS RD

WILEY MAE RD

PM 2987

2-1/2"

3"

5"

3"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

5"

2-1/2"

2-1/2"

3"

3"

DISTRICT BOUNDARY

- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE



SCALE: 1"=300'

SHEET 4

SHEET 12

YOUNGBLOOD DR

SMITY DR

PENDER RD

WILEY MAE RD

FM 2837

CRAWFORD DR

FM 92

GORE STORE RD

BEAN

BEAN

2-1/2"

2-1/2"

MCDONALD RD

SHEET 14

LEGEND

- GATE VALVE
- FLUSH VALVE
- ⊕ FIRE HYDRANT
- SAMPLE SITE



SCALE: 1"=300'

MCDONALD RD
SHEET 13

SHEET 5

SHEET 19

SHEET 15

OLD KOUNZE RD.

FM 92

2-1/2"

2-1/2"

FM 2837

SPERLING

SAMPLE SITE #7
GORE

OLD ARCO RD

WILLIFORD

OLD ARCO RD

OLD ARCO RD



ELSIE GORE

FM 2837

BOURLON

LEGEND

- GATE VALVE
- FLUSH VALVE
- ⊕ FIRE HYDRANT
- SAMPLE SITE

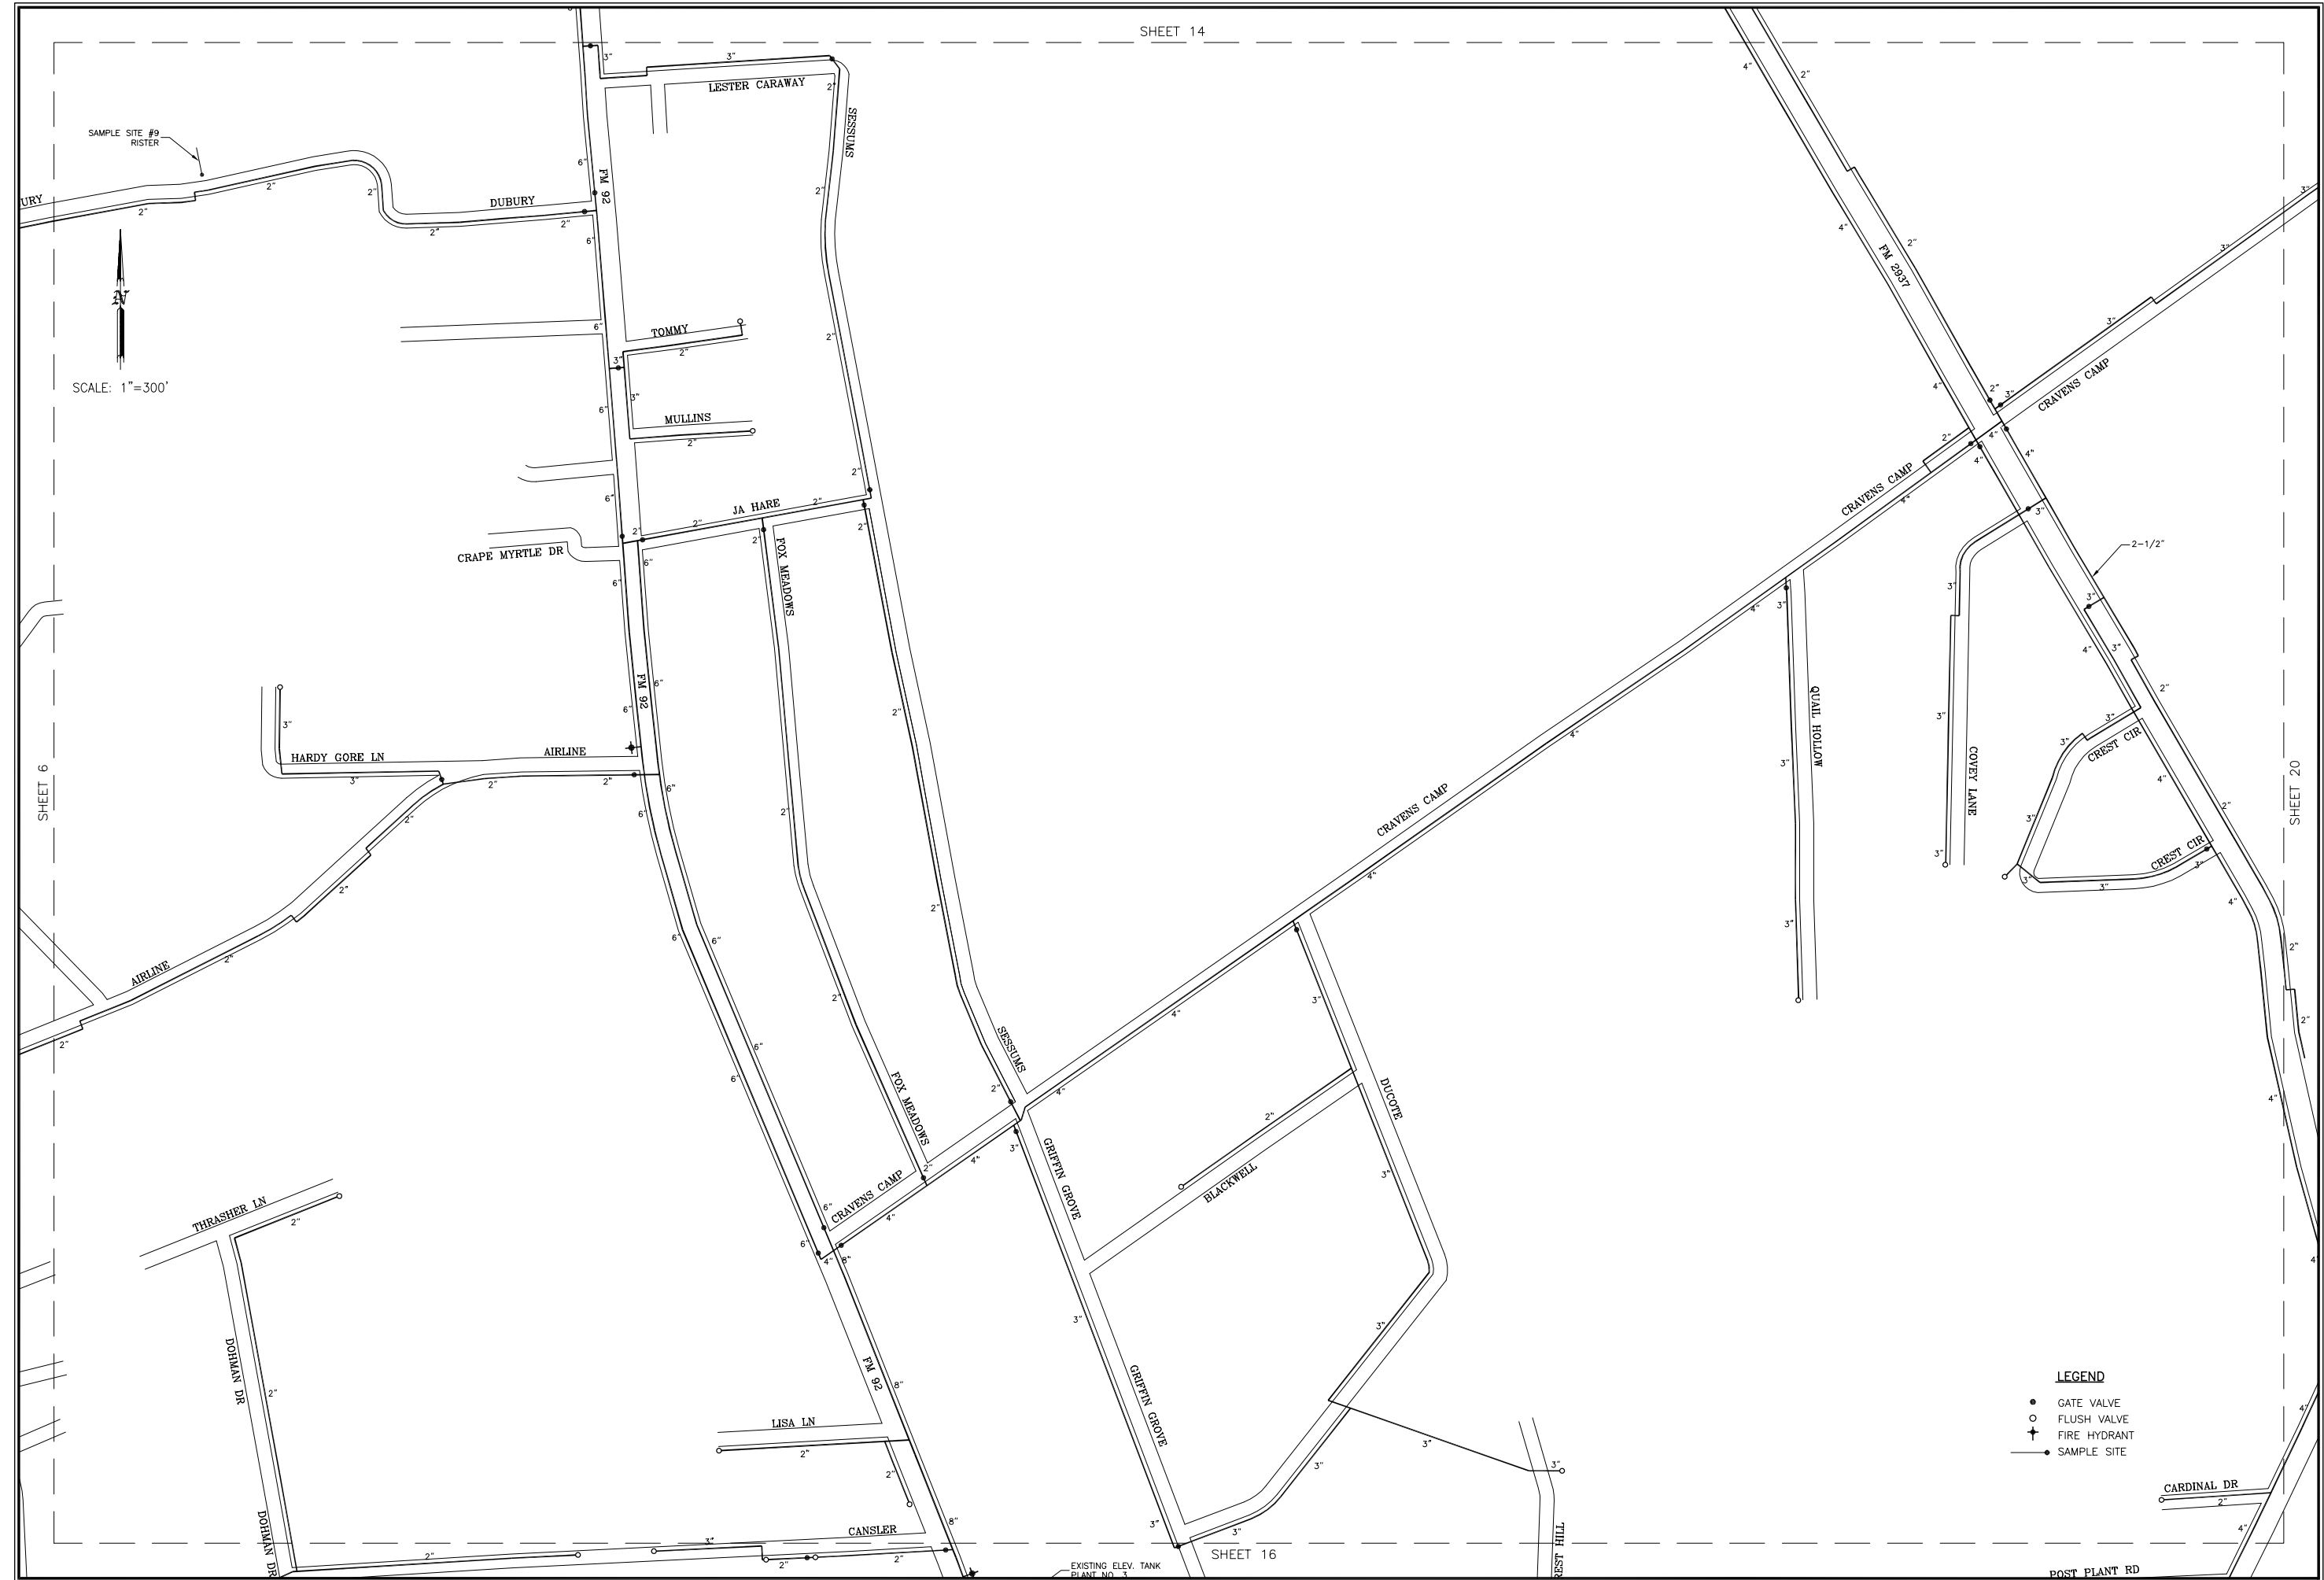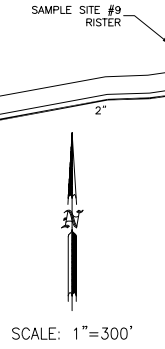


SHEET 6

SHEET 20

SHEET 16

- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE

EXISTING ELEV. TANK PLANT NO. 3






SHEET 15

SHEET 7

SHEET 21

SHEET 17



- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE

SCALE: 1"=300'



- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE



SCALE: 1"=300'

SHEET 14

DISTRICT BOUNDARY

FRANKLIN LAKE RD


CRAVENS CAMP

OLD ARCO RD


- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - † FIRE HYDRANT
 - SAMPLE SITE

SHEET 20

SHEET 19



- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE

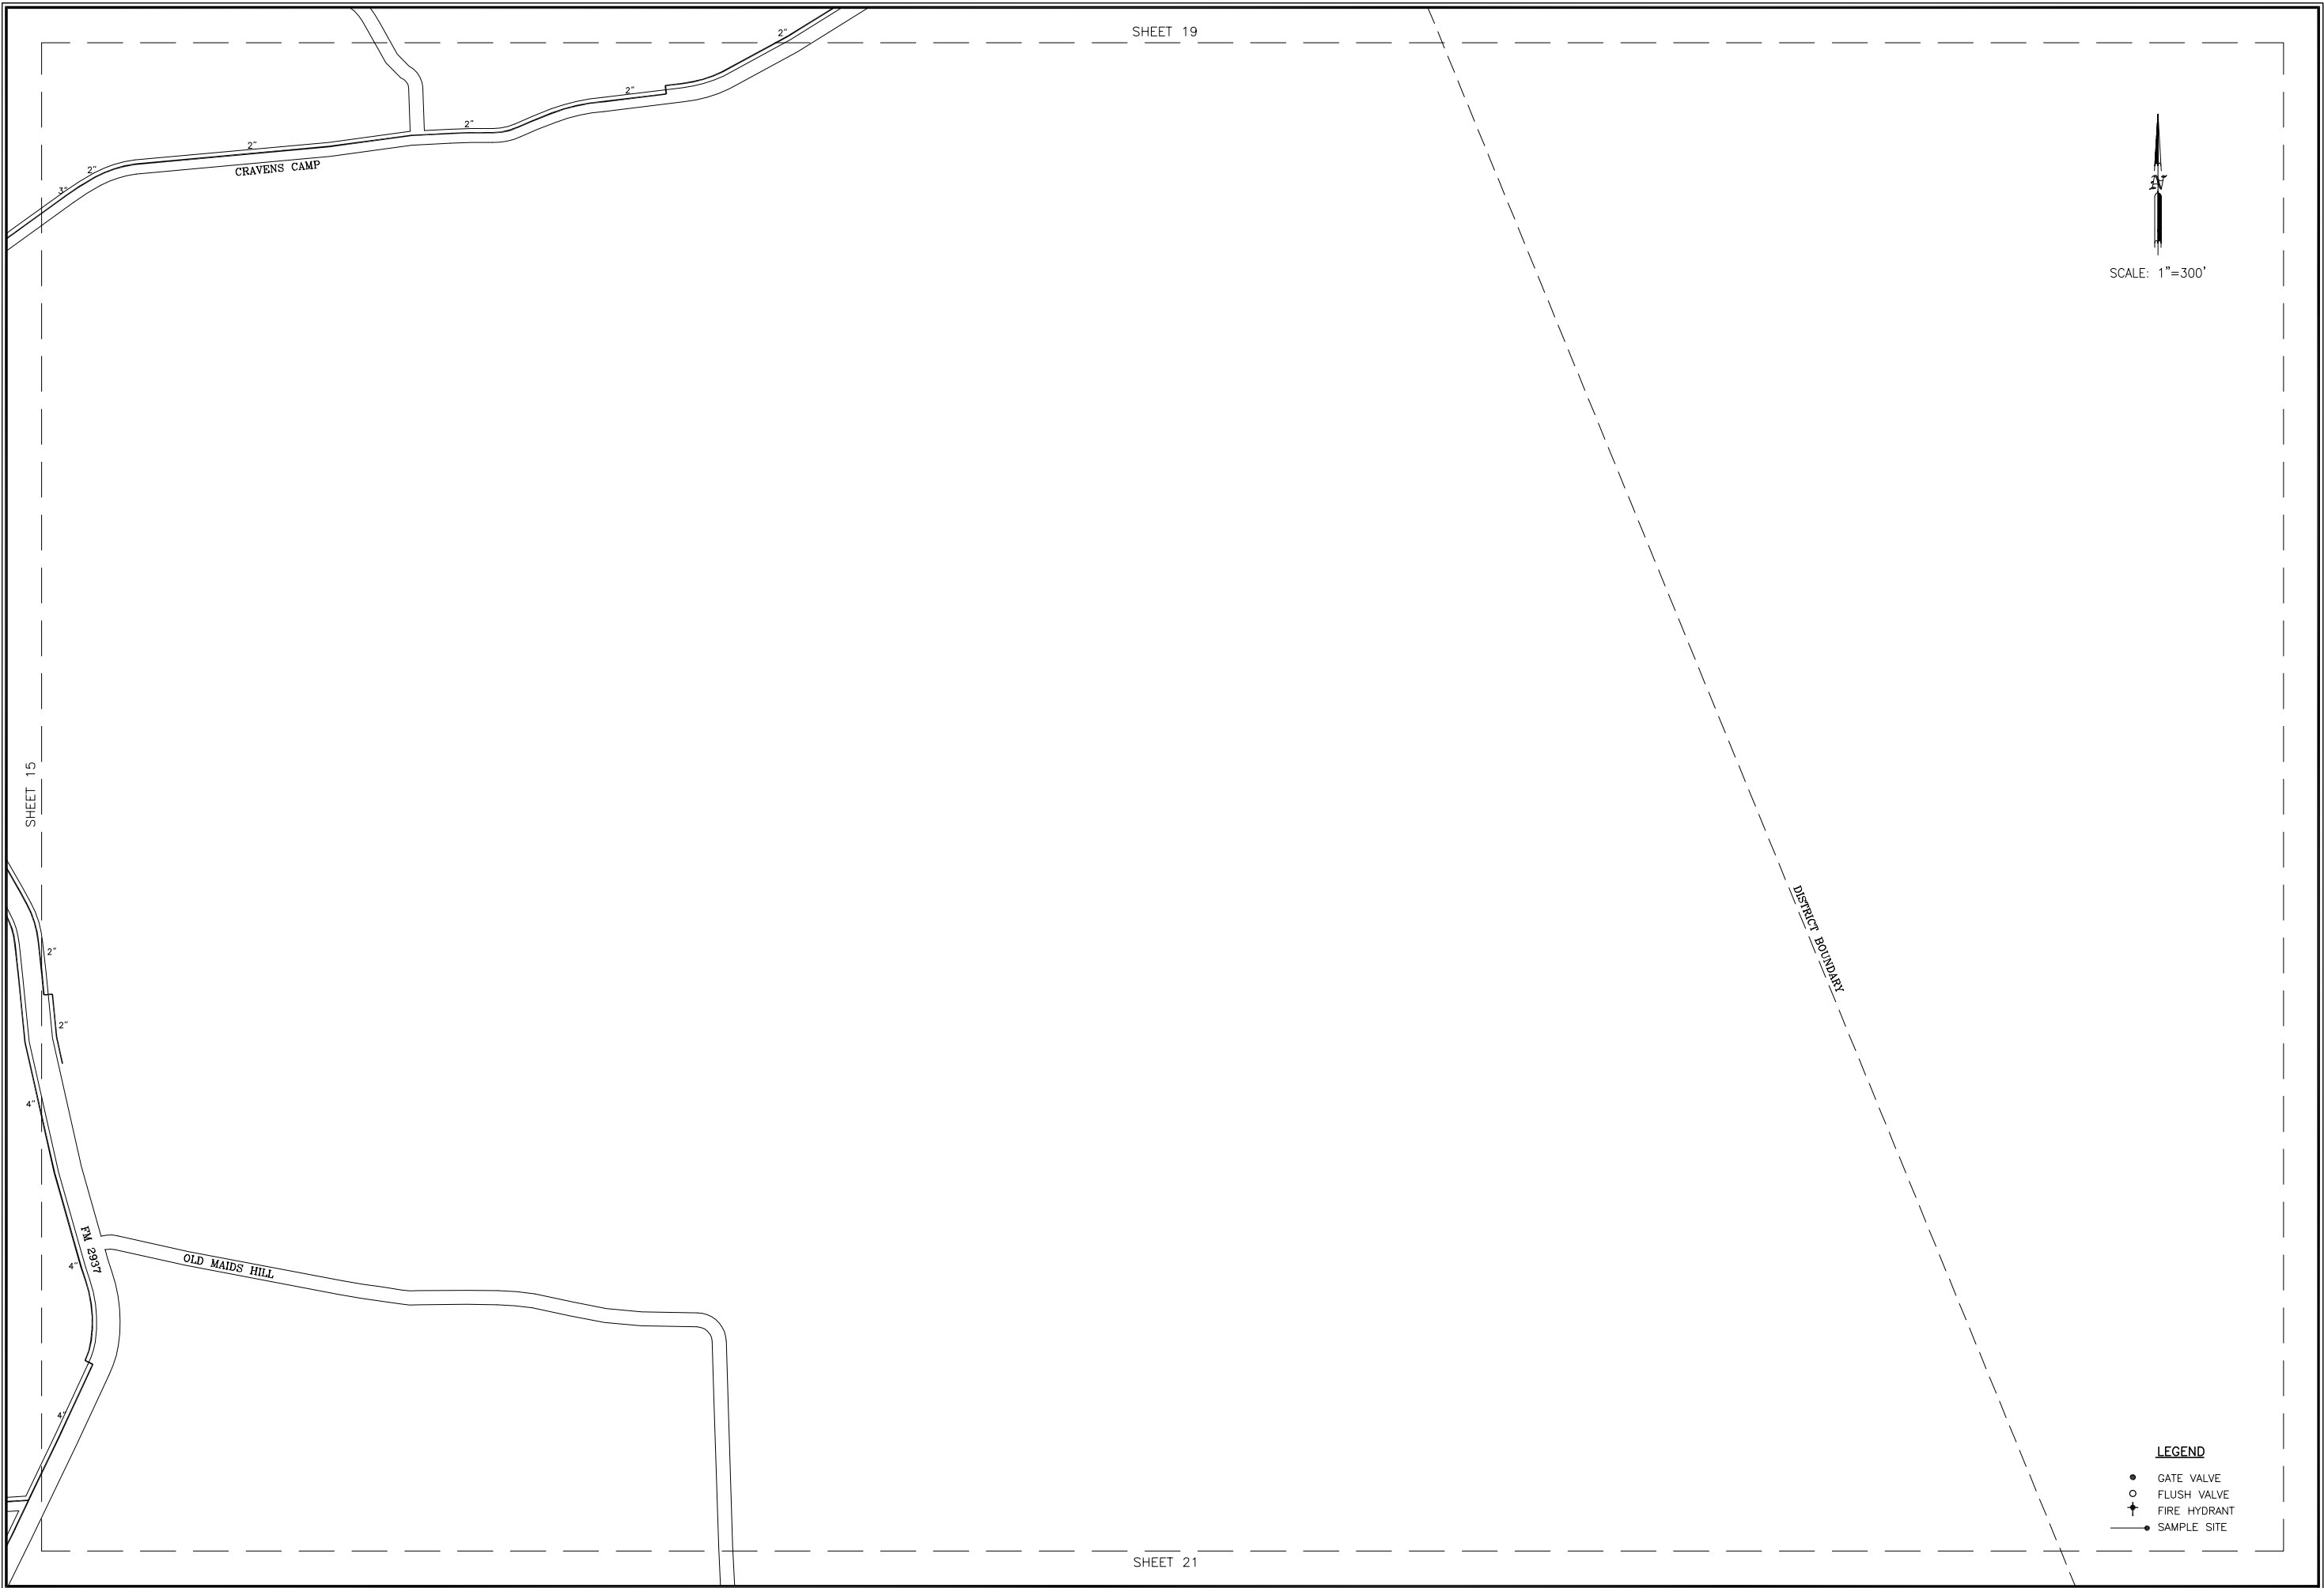

SHEET 20



SCALE: 1"=300'

OLD MAIDS HILL

TEJAS LN

2"

SHEET 16

DISTRICT BOUNDARY

SANGWIN


2"

SHEET 22

- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - † FIRE HYDRANT
 - SAMPLE SITE



SCALE: 1"=300'

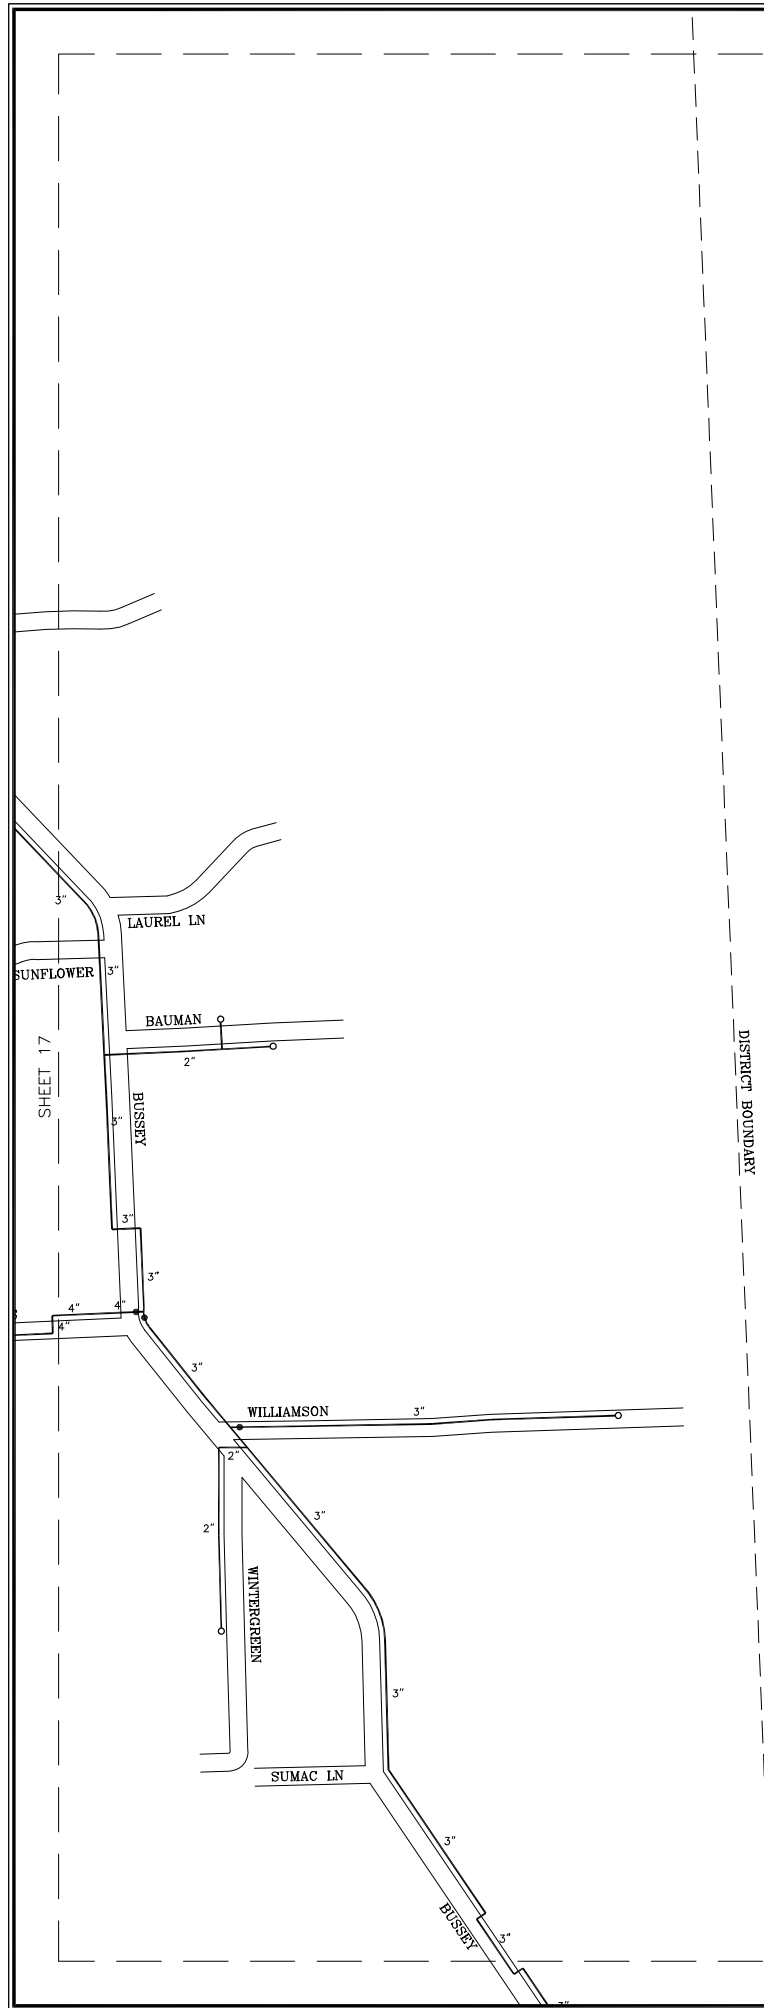

- LEGEND**
- GATE VALVE
 - FLUSH VALVE
 - ⊕ FIRE HYDRANT
 - SAMPLE SITE



SCALE: 1"=300'



SHEET 18

LEGEND

- GATE VALVE
- FLUSH VALVE
- ⊕ FIRE HYDRANT
- SAMPLE SITE